



Potential Transmission development in the Valleyview area

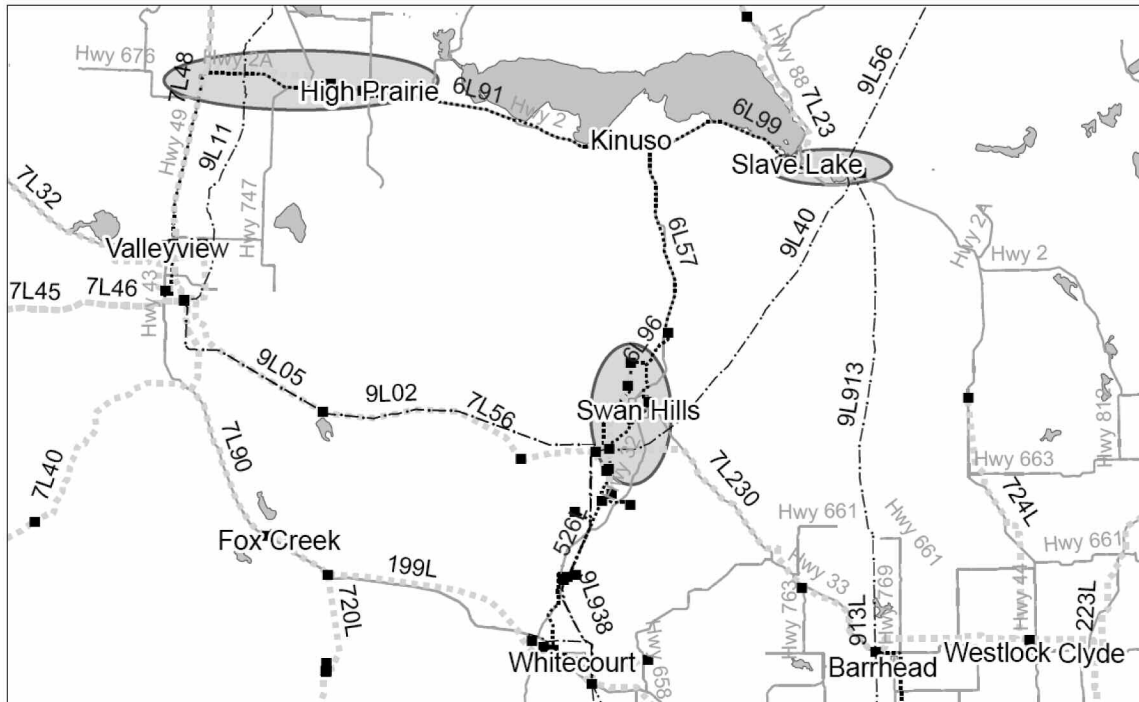

Potential Transmission Development

 Areas of consideration for potential transmission facilities

-  Existing Substations
-  Existing 240 kV Transmission Lines
-  Existing 144 kV Transmission Lines
-  Existing 72 kV Transmission Lines

The Alberta Electric System Operator (AESO) has verified the need to reinforce the electricity transmission system in the Valleyview area and the surrounding areas of High Prairie, Swan Hills and Slave Lake. Demand for electricity has grown from 510 MW in 2002 to 532 MW in 2006 and is expected to reach 600 MW by 2016.

The shaded areas in the map illustrates the areas of study for locating facilities.

The target in-service date for these developments is 2010.


No proposals have been made and no final decisions have been made at this time.

We are preparing an application for submission to the Alberta Utilities Commission and would like to collect your feedback and suggestions for consideration in our application. Please provide comment to:

Doug Downs
AESO
2500, 330 5th Ave SW
Calgary, AB T2P 0L4

stakeholder.relations@aesocanada.com
1.888.866.2959

www.aeso.ca

 <small>Integrated Marketing Communications</small>	
Artist:	2N
<i>Production Only</i>	
Docket:	103024
Date:	Apr 18, 2008
Size:	6.75"
Proof:	2
1 of 1	
Publication(s): Valleyview VV Fox Creek Times	