


aeso

33 - Fort Saskatchewan

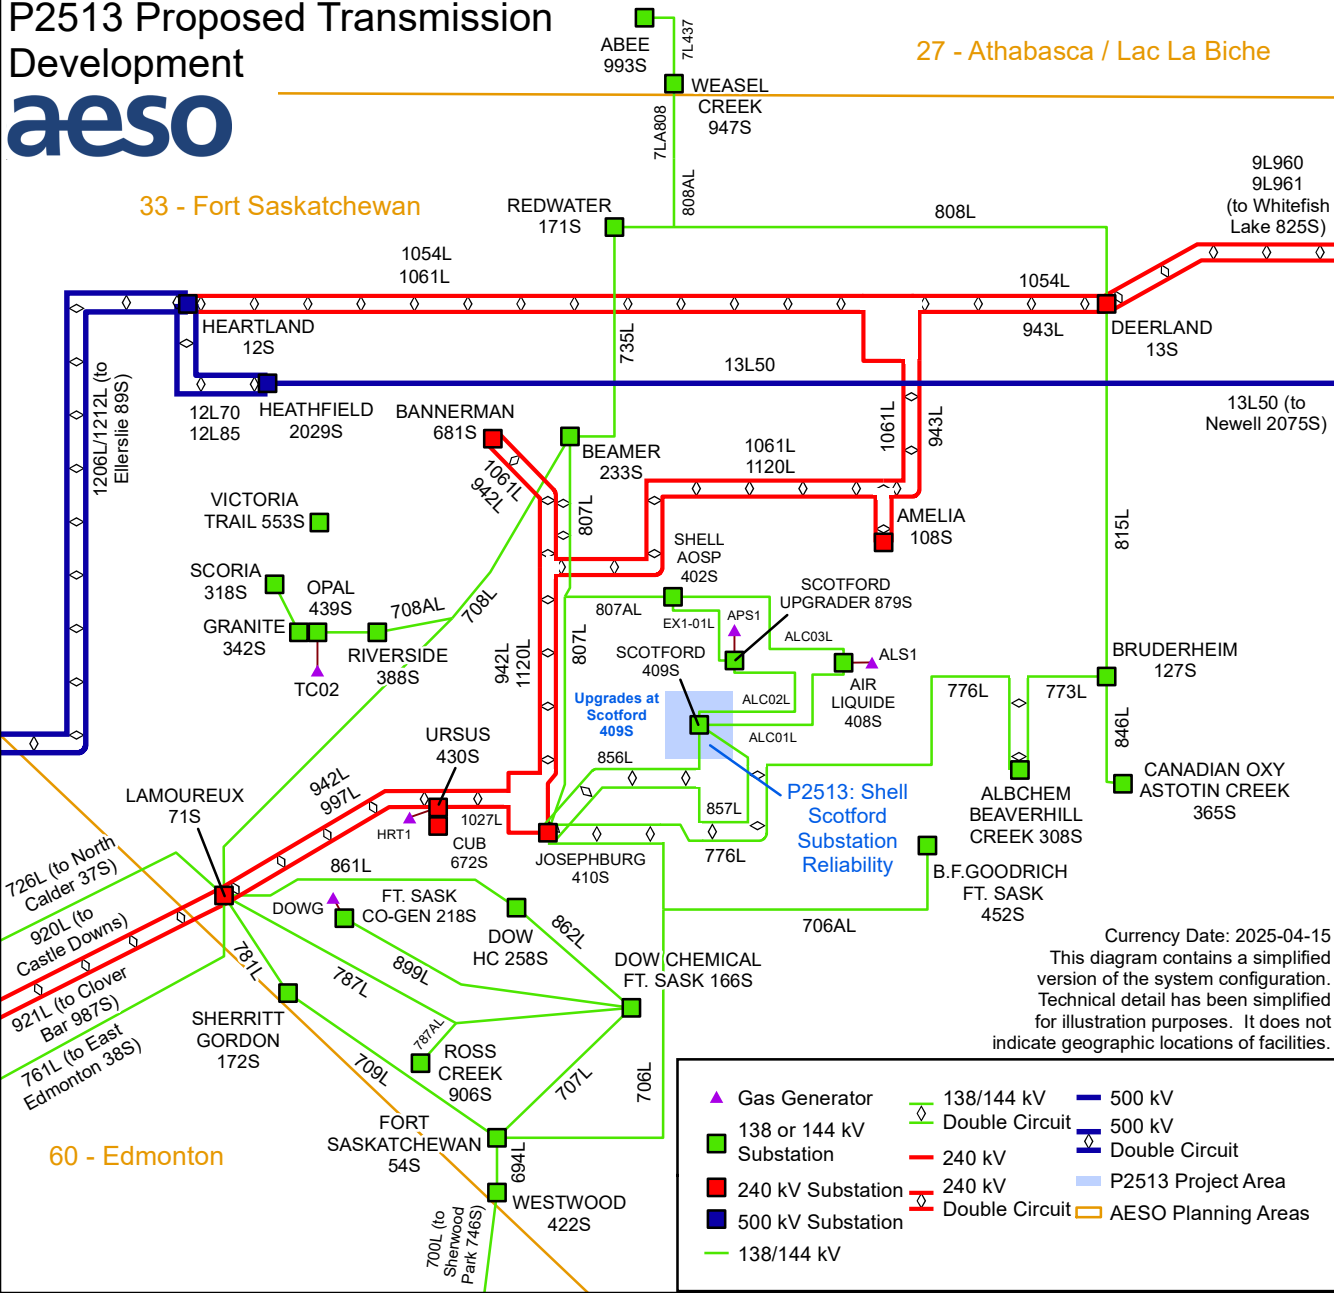

This diagram contains a simplified version of the system configuration. Technical detail has been simplified for illustration purposes. It does not indicate geographic locations of facilities.

-  Gas Generator  138/144 kV  500 kV
 138 or 144 kV Substation  Double Circuit  500 kV
 240 kV Substation  240 kV  Double Circuit
 500 kV Substation  240 kV Double Circuit  P2513 Project Area
 138/144 kV  AESO Planning Areas