



Pearson correlation coefficient of 240kV line hourly power flow with hourly DTS load by AESO planning region for 2018 (for all hours, off-peak and peak)

All Hours

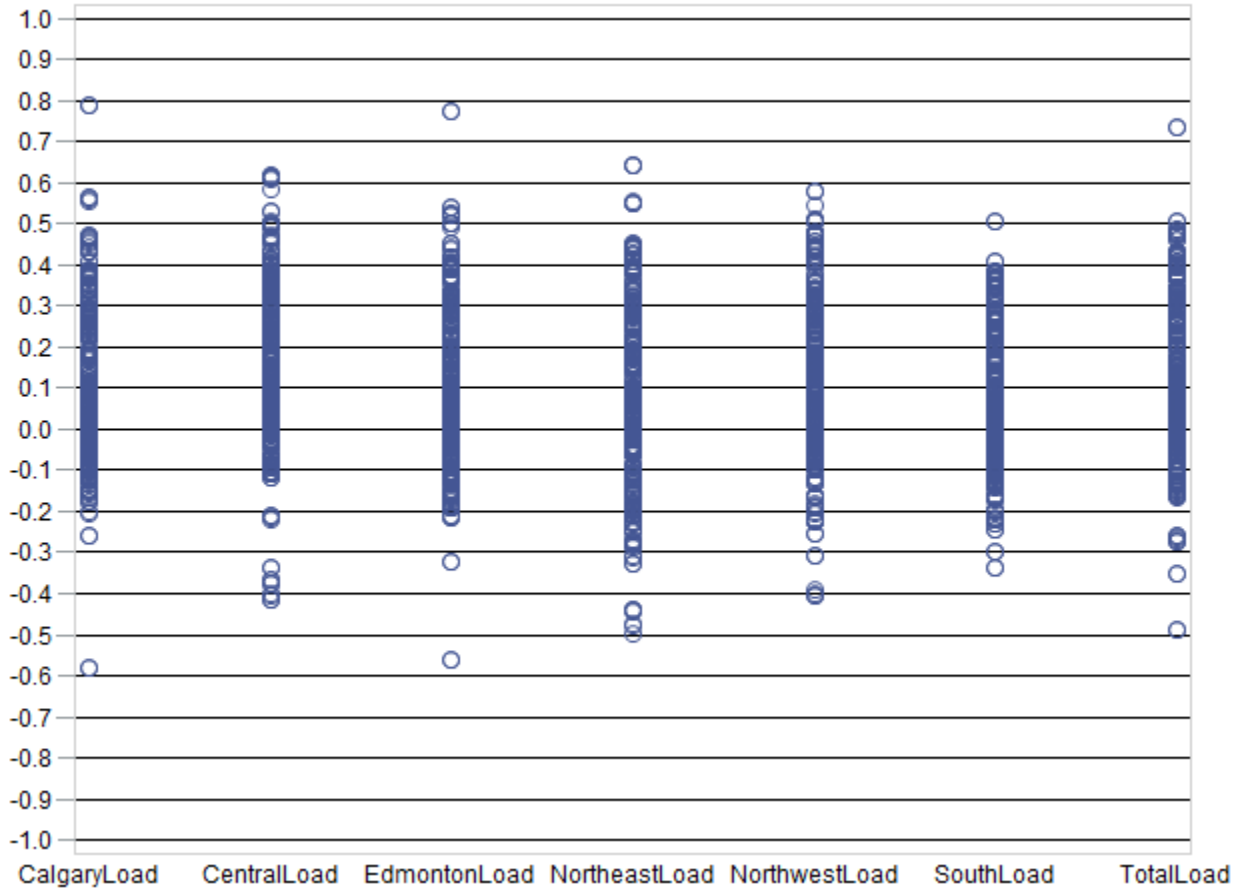

Off-Peak Hours (weekends, holidays, 11PM-7AM)

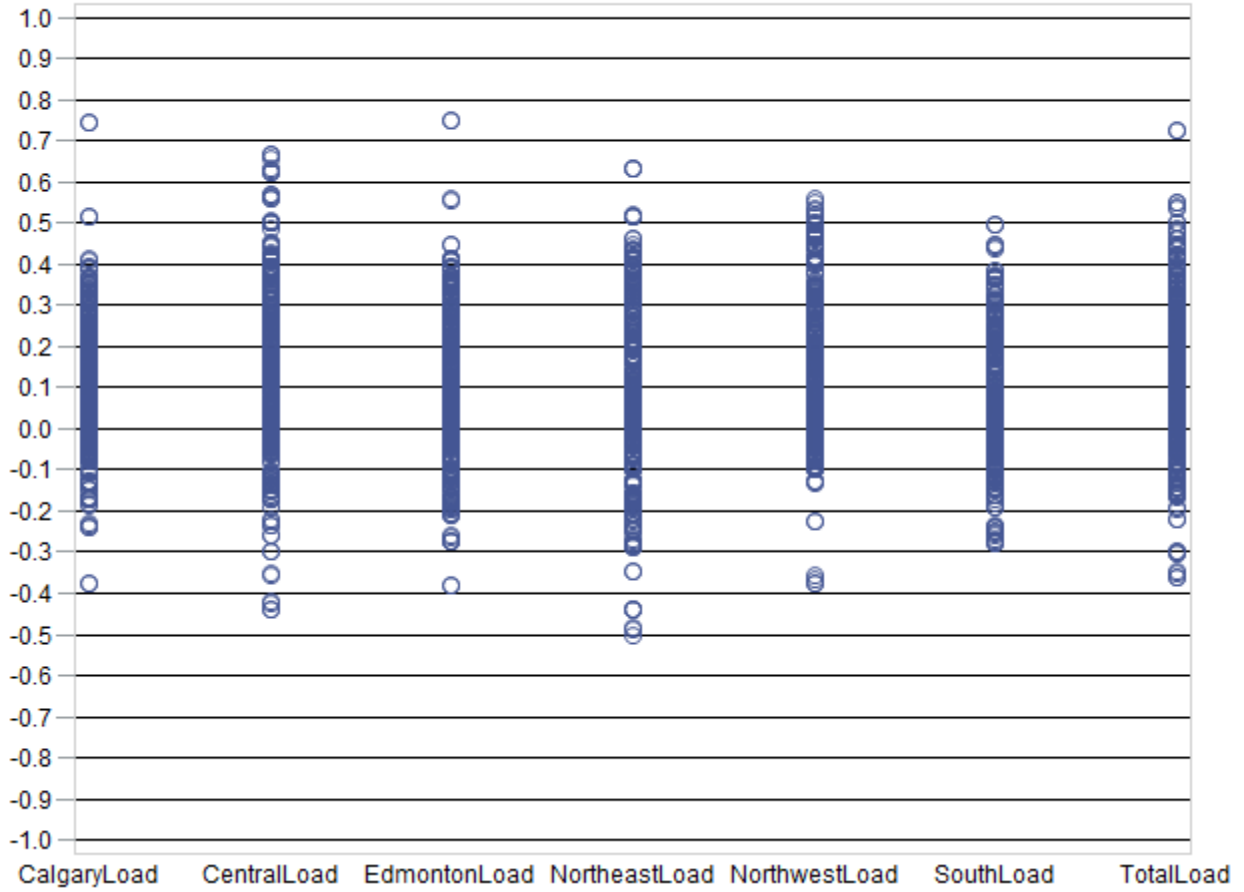

Peak Hours Hours (non weekends non holiday 7AM-11PM)

